



REV.	DESCRIPTION	DATE	BY
1	NEW WIRE COLOR CHANGE; AUX SW. WIRE	15MAR16	WJR
2	WIRING DIAGRAM FOR 115VAC ONLY	14APR16	WJR

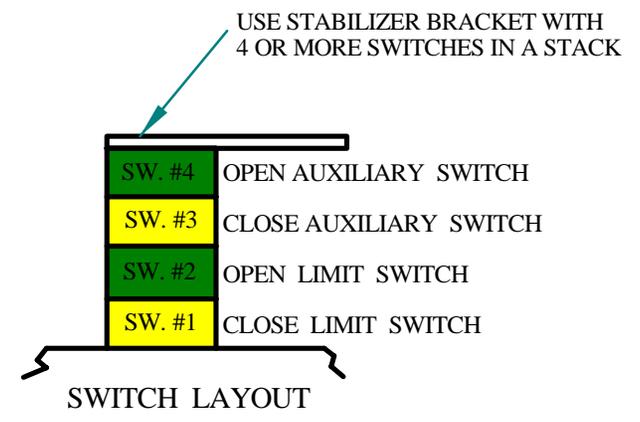

NOTES:  
 POWER TO TERMINALS ONE & TWO OPENS THE VALVE (CCW ROTATION).  
 POWER TO TERMINALS ONE & THREE CLOSES THE VALVE (CW ROTATION).  
 TERMINALS 4 THROUGH 9 FOR AUXILIARY SWITCH CONNECTIONS.  
 AUXILIARY SWITCHES MAY BE SET TO ANY DESIRED POSITION THROUGHOUT THE ACTUATOR TRAVEL.

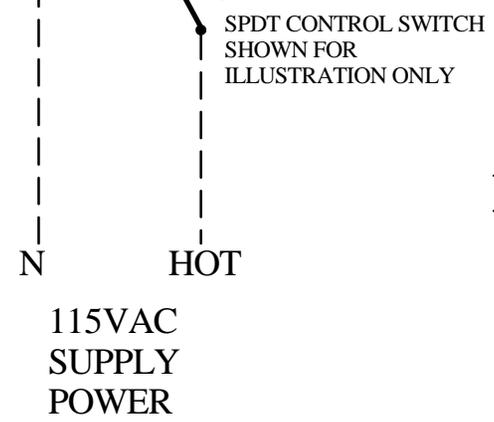

## FIELD WIRING

SWITCH NO.	CONTACTS WIRED	OPEN	MID	CLOSE
1	NO	—————		
	NC			—————
2	NO		—————	
	NC	—————		
3	NO	—————		
	NC			—————
4	NO	—————		
	NC	—————		

**IC<sub>I</sub>** Indelac Controls, Inc.  
 Florence, Ky 41042

WIRING DIAGRAM. 115VAC ELECTRIC ACTUATOR, WITH OPTIONAL 2 AUX. SWITCHES, BRAKE & HEATER/THERMOSTAT

JLR 4-5-99  
**W990405**